



NOTES

1. All Septic Tanks must be pumped out
2. Steel tanks should be crushed or cut off 2 feet below the surface and filled with clean soil or stone
3. Concrete tanks should be filled with clean soil or stone
4. Backfill materials for the basin shall be clean, free flowing gravel or aggregate with angular particle size not less than 1/8 inch nor more than 1/2 inch diameter

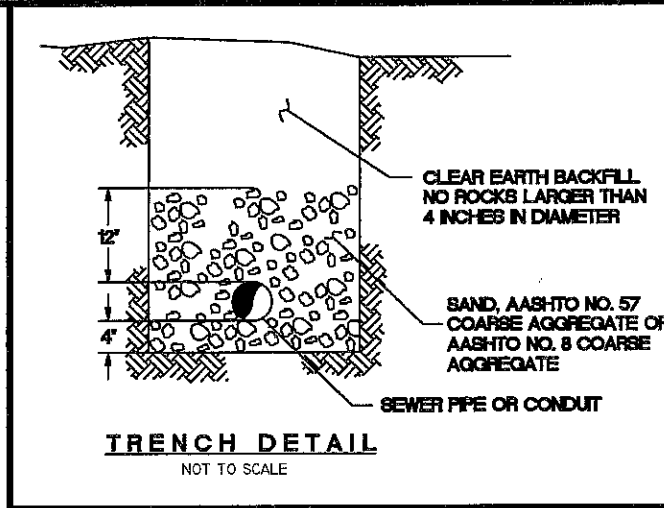

Equipment To Be Supplied By Sewer Authority

1. Grinder Pump Unit
2. Control Panel
3. Redundant Check Valve with Whip
4. Pumps are supplied with 50 feet of electrical cable. Longer lengths can be ordered from Site Specific Design, Inc. by calling 215-887-3730 (cost to be borne by home owner)
5. The standard grinder pump housing depth is 93 inches. Extensions can be ordered from Site Specific Design, Inc. 215-887-3730 (cost to be borne by home owner)

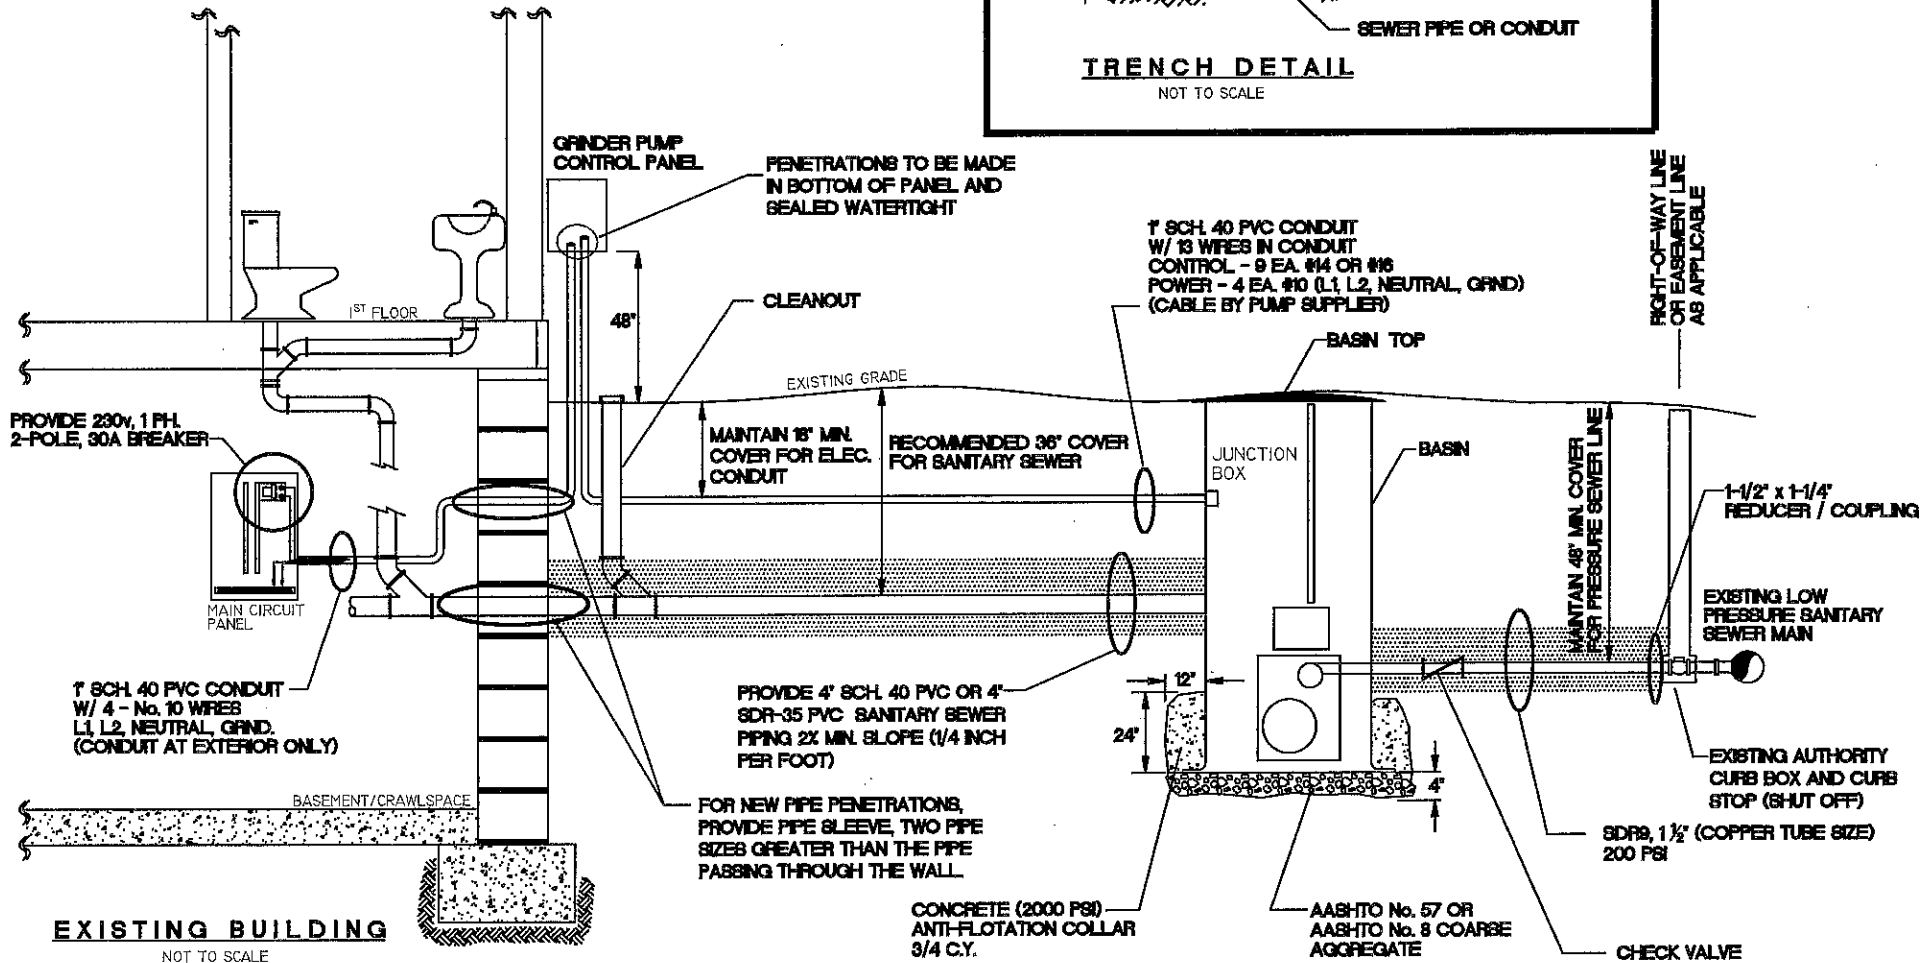

**SCOTT TOWNSHIP SEWER AND WATER AUTHORITY
GRINDER PUMP UNIT / PIPING
INSTALLATION DETAIL**

NOT TO SCALE